QRG


FLUKE ®

1630-2/1630-2 FC
Earth Ground Clamp

1+844-427-2296

https://www.fluke.com/en-us/products/fluke-software/connect

FLUKE CONNECT®

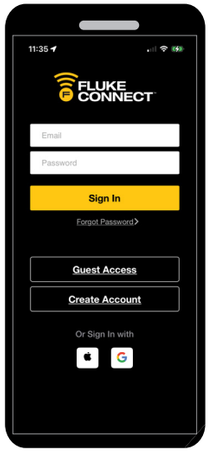



iOS

Android





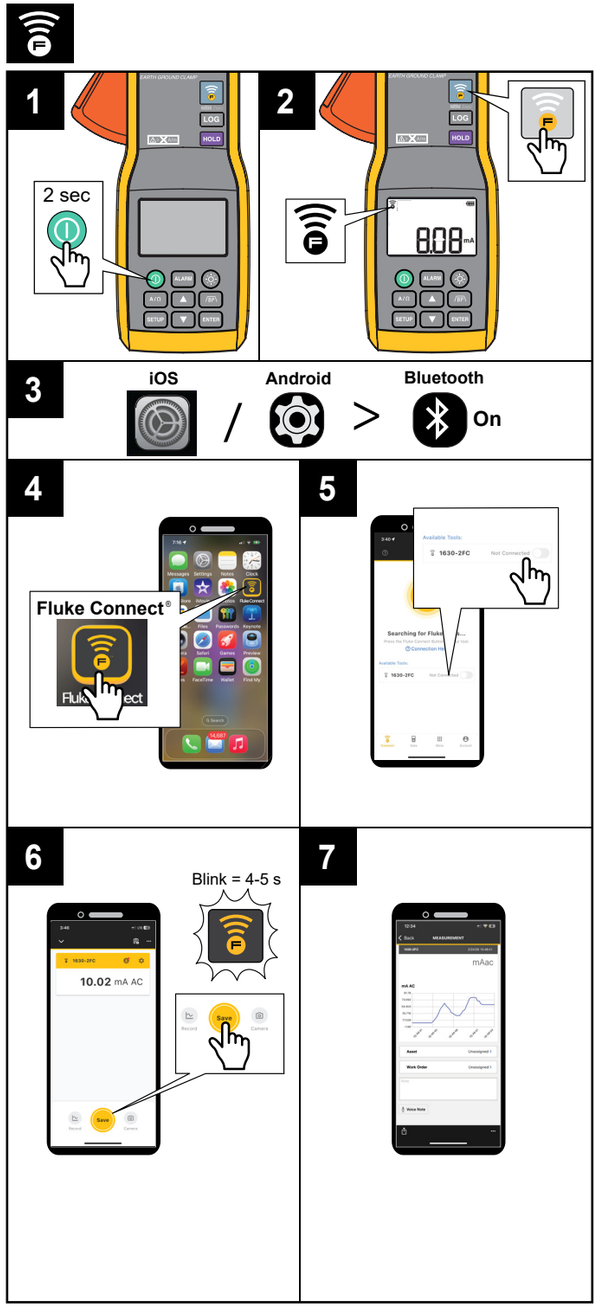

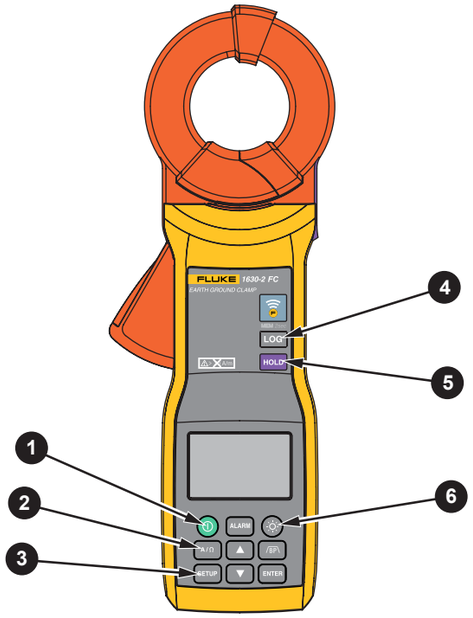

1


>2 sec = ON >2 sec = OFF


>20 m (no use) = Auto-OFF

2 A/Ω **A** A/Ω **Ω**

3 SETUP >


- Log interval
- Alarm threshold
- Time
- Clamp settings

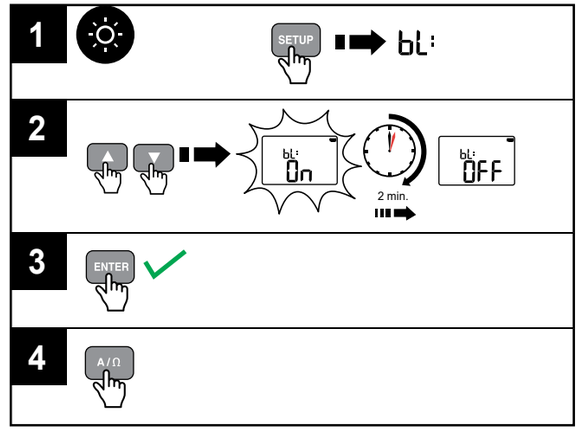

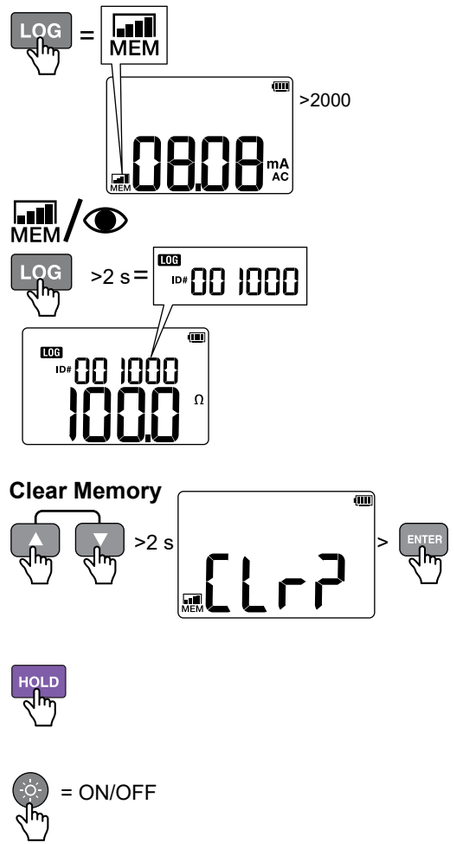


PN 4830595 October 2016 Rev. 1, 3/26
© 2024-2026 Fluke Corporation. All rights reserved.

1

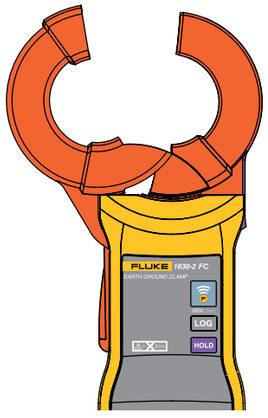

2

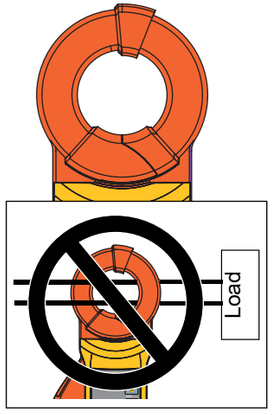

3





5 s





4



A/Ω

Ω

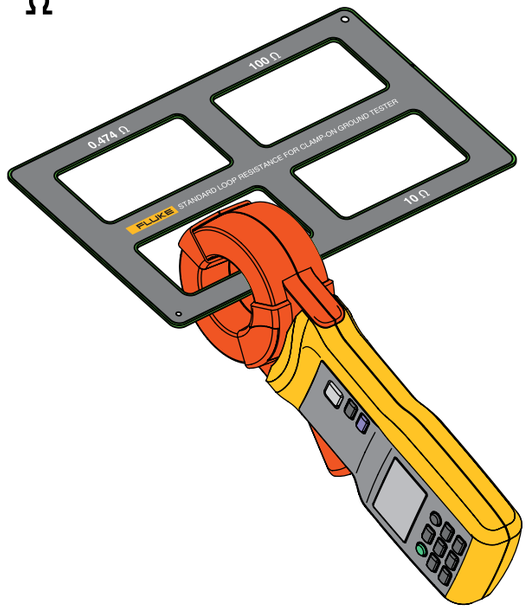


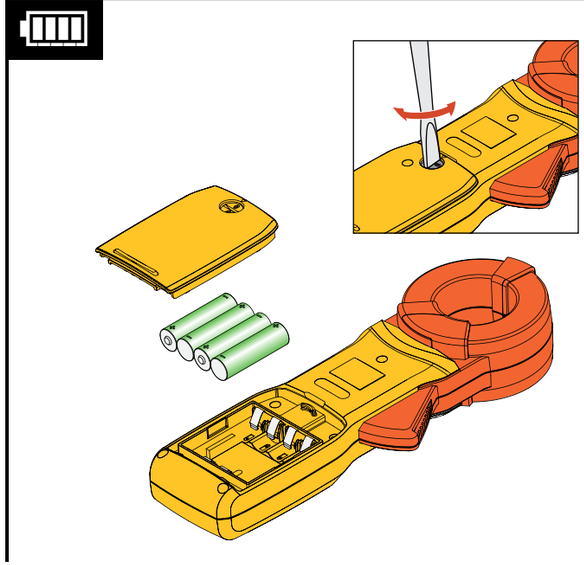


A/Ω


Ω

Ground resistance measurements principle:

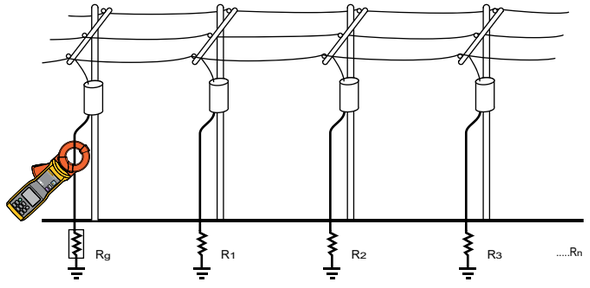

Equivalent circuit diagram:

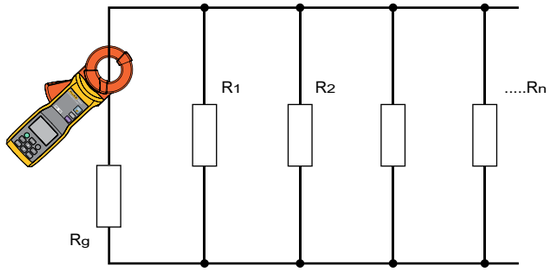





A/Ω

m A


Single-Phase Two-Wire Circuit



Single-Phase Three-Wire or Three-Phase Three-Wire Circuit

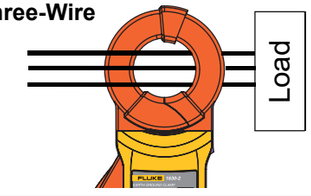

Load Current

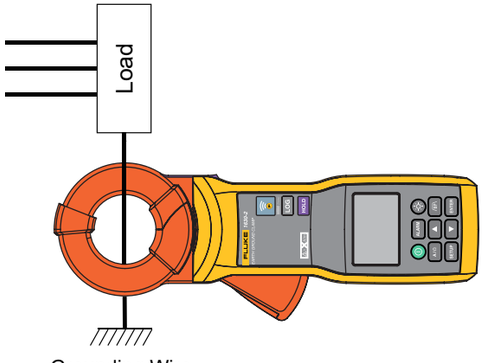

Grounding Wire

